


**Fit Group**

**Oneway Analysis of 42 day weight By Treatment**

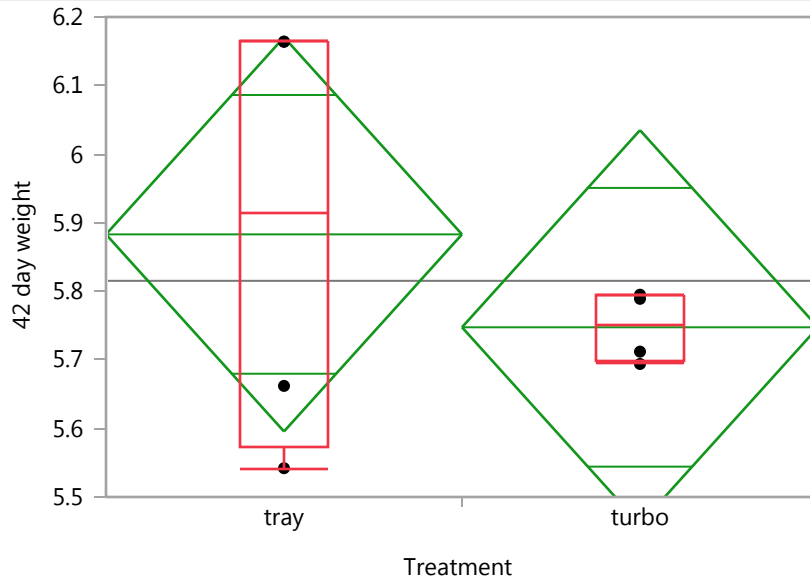

Missing Rows 1

**Quantiles**

Level	Minimum	10%	25%	Median	75%	90%	Maximum
tray	5.542	5.542	5.572	5.913	6.164	6.164	6.164
turbo	5.694	5.694	5.6985	5.7505	5.7935	5.795	5.795

**Oneway Anova**

**Summary of Fit**


Rsquare	0.09982
Adj Rsquare	-0.05021
Root Mean Square Error	0.234927
Mean of Response	5.81525
Observations (or Sum Wgts)	8

**t Test**

turbo-tray

Assuming equal variances

Difference	-0.13550	t Ratio	-0.81568
Std Err Dif	0.16612	DF	6
Upper CL Dif	0.27098	Prob >  t	0.4458
Lower CL Dif	-0.54198	Prob > t	0.7771
Confidence	0.95	Prob < t	0.2229

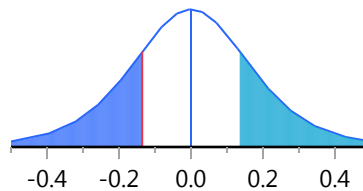

**Fit Group**

**Oneway Analysis of 42 day weight By Treatment**

**Oneway Anova**

**Analysis of Variance**


		Sum of			
Source	DF	Squares	Mean Square	F Ratio	Prob > F
Treatment	1	0.03672050	0.036721	0.6653	0.4458
Error	6	0.33114500	0.055191		
C. Total	7	0.36786550			

**Means for Oneway Anova**

Level	Number	Mean	Std Error	Lower 95%	Upper 95%
tray	4	5.88300	0.11746	5.5956	6.1704
turbo	4	5.74750	0.11746	5.4601	6.0349

Std Error uses a pooled estimate of error variance

**Oneway Analysis of 42 Day FE By Treatment**

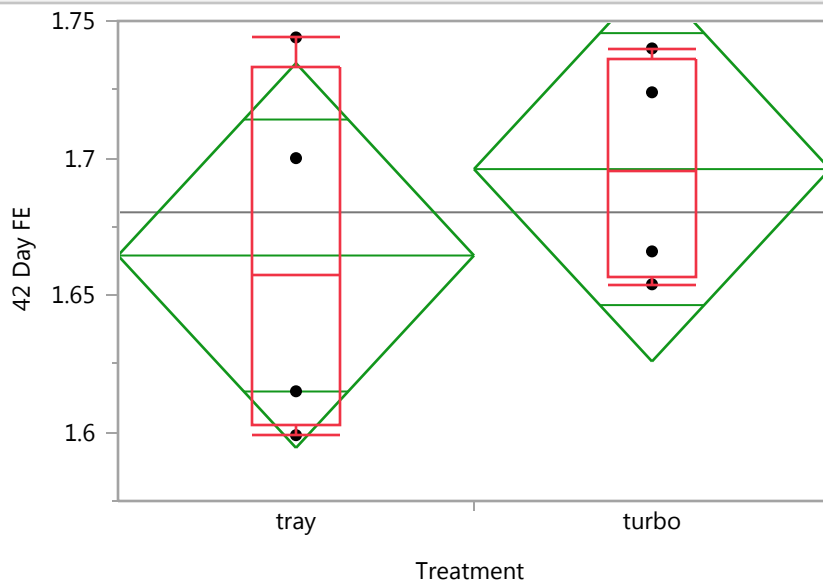

Missing Rows 1

**Quantiles**

Level	Minimum	10%	25%	Median	75%	90%	Maximum
tray	1.599	1.599	1.603	1.6575	1.733	1.744	1.744
turbo	1.654	1.654	1.657	1.695	1.736	1.74	1.74

**Fit Group**

**Oneway Analysis of 42 Day FE By Treatment**

**Oneway Anova**

**Summary of Fit**


Rsquare	0.091496
Adj Rsquare	-0.05992
Root Mean Square Error	0.057308
Mean of Response	1.68025
Observations (or Sum Wgts)	8

**t Test**

turbo-tray

Assuming equal variances

Difference	0.03150	t Ratio	0.777343
Std Err Dif	0.04052	DF	6
Upper CL Dif	0.13066	Prob >  t	0.4665
Lower CL Dif	-0.06766	Prob > t	0.2332
Confidence	0.95	Prob < t	0.7668

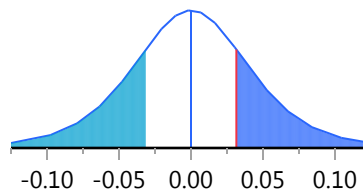

**Analysis of Variance**

Source	DF	Sum of Squares	Mean Square	F Ratio	Prob > F
Treatment	1	0.00198450	0.001984	0.6043	0.4665
Error	6	0.01970500	0.003284		
C. Total	7	0.02168950			

**Means for Oneway Anova**

Level	Number	Mean	Std Error	Lower 95%	Upper 95%
tray	4	1.66450	0.02865	1.5944	1.7346
turbo	4	1.69600	0.02865	1.6259	1.7661

Std Error uses a pooled estimate of error variance